



.....
1335 W. Cass Street

Tampa, FL 33606

(813) 251-9244

Fax: 251-9330

www.broadway-eng.com
.....

**SERIES NS213, MS380, AND WS500
OFFSET PIVOT DOORS
STOREFRONT SYSTEM**

CIVIL


MECHANICAL

STRUCTURAL

BUILDING DESIGN
.....

CORAL INDUSTRIES

3010 Rice Mine Rd ♦ Tuscaloosa, AL ♦ 35406 ♦ (800) 772-7737

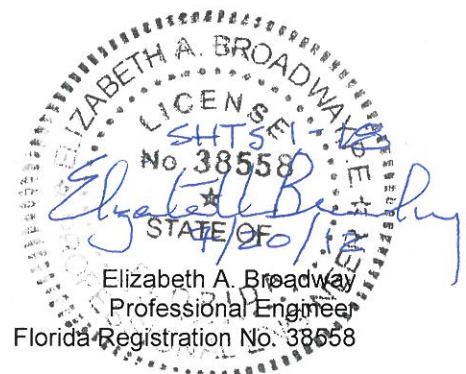

Elizabeth A. Broadway
Professional Engineer
Florida Registration No. 38558

PRODUCT APPROVAL SUBMITTAL

REFER TO DESIGN DRAWINGS FL200_4, SHEETS 1 TO 13, DATED 7/18/12

A. SERIES NS213 DOOR IN FL200 FRAMING

1. DESIGN WIND LOAD AS PER TESTING

$$P = +25 / -25 \text{ PSF}$$

2. FRAMING SYSTEM

FL200 UNREINFORCED JAMBS

3. GLASS

TYPE T: 1/4" TEMPERED GLASS

MANUFACTURER: VARIES

MAXIMUM D.L.O. - 31" x 90" (19.1 ft²)

4. TESTED ASSEMBLY

73-3/4" x 85-3/4"

5. ANALYSIS FOR UNREINFORCED JAMB

CHECK STRESS AND DEFLECTION

$$F_b \text{ FOR ALUMINUM} = 25 \text{ ksi} / 1.65 = 15.15 \text{ ksi}$$

$$F_b \text{ FOR STEEL} = 36 \text{ ksi} \times 0.67 = 24 \text{ ksi}$$

$$I_x = 2.700 \text{ in}^4$$

$$S_x = 1.233 \text{ in}^3$$

$$M := 0.166 \text{ k-ft (FROM PG. 7)}$$

$$F_b := 15.15 \text{ ksi}$$

$$S_{\text{req}} := \frac{M \cdot 12}{F_b}$$

$$S_{\text{req}} = 0.131 \text{ in}^3 < S_x = 1.233 \text{ in}^3 \text{ OK}$$

$$\Delta = L / 6608 < L / 175 \text{ OK (FROM PG. 7)}$$

6. CHECK REACTION AT MULLION ENDS

$$R_{\text{end}} = 123 \text{ lb (FROM PG. 6)}$$

7. CHECK SHEAR CAPACITY FOR ANCHORS

$$V_{\text{allow}} := 384 \text{ lb} > R_{\text{end}} = 123 \text{ lb OK (FOR 1/4" } \phi \text{ TAPCONS, FROM PG. 15)}$$

$$V_a := 1100 \text{ lb} > R_{\text{end}} = 123 \text{ lb OK (FOR 3/8" } \phi \text{ BOLT, FROM PG. 16)}$$

$$V_{\text{ult}} := 1395 \text{ lb (FOR 1/4-14 SCREWS, FROM PG. 17)}$$

$$V_a := \frac{V_{ult}}{3} \quad (\text{WITH S.F. OF 3})$$

$$V_a = 465 \quad \text{lb} > R_{end} = 123 \text{ lb} \quad \underline{OK}$$

$$V_a := 190 \quad \text{lb} > R_{end} = 123 \text{ lb} \quad \underline{OK} \quad (\text{FOR \#14 WOOD SCREW, FROM PG. 18})$$

8. CHECK REACTION AT INTERMEDIATE ANCHOR IN JAMB

$$R_{end} = 408 \text{ lb} \quad (\text{FROM PG. 6})$$

9. CHECK SHEAR CAPACITY FOR ANCHORS

$$V_{allow} := 384 \quad \text{lb} > R_{end} = 968 \text{ lb} \quad \underline{OK} \quad (\text{FOR } 1/4" \phi \text{ TAPCONS, FROM PG. 15})$$

$$V_{tot} := V_{allow} \cdot 2 \quad (\text{FOR (2) TAPCONS})$$

$$V_{tot} = 768 \quad \text{lb} > R_{end} = 408 \text{ lb} \quad \underline{OK}$$

$$V_a := 1100 \quad \text{lb} > R_{end} = 408 \text{ lb} \quad \underline{OK} \quad (\text{FOR } 3/8" \phi \text{ BOLT, FROM PG. 16})$$

$$V_{ult} := 1395 \quad \text{lb} \quad (\text{FOR } 1/4\text{-}14 \text{ SCREWS, FROM PG. 17})$$

$$V_a := \frac{V_{ult}}{3} \quad (\text{WITH S.F. OF 3})$$

$$V_a = 465 \quad \text{lb} > R_{end} = 408 \text{ lb} \quad \underline{OK}$$

$$V_a := 190 \quad \text{lb} \quad (\text{FOR \#14 WOOD SCREW, FROM PG. 18})$$

$$V_{tot} := V_a \cdot 3 \quad (\text{FOR (3) SCREWS})$$

$$V_{tot} = 570 \quad \text{lb} < R_{end} = 408 \text{ lb} \quad \underline{OK}$$

B. SERIES NS213 DOOR IN FL200 FRAMING WITH TRANSOM

1. DESIGN WIND LOAD AS PER TESTING

$$P = +25 / -25 \text{ PSF}$$

2. FRAMING SYSTEM

FL200 UNREINFORCED JAMBS

3. GLASS

TYPE T: 1/4" TEMPERED GLASS

MANUFACTURER: VARIES

MAXIMUM D.L.O. - 31" x 90" (19.1 ft²)

4. TESTED ASSEMBLY

73-3/4" x 85-3/4"

5. ANALYSIS FOR UNREINFORCED JAMB

CHECK STRESS AND DEFLECTION

$$F_b \text{ FOR ALUMINUM} = 25 \text{ ksi} / 1.65 = 15.15 \text{ ksi}$$

$$F_b \text{ FOR STEEL} = 36 \text{ ksi} \times 0.67 = 24 \text{ ksi}$$

$$I_x = 2.700 \text{ in}^4$$

$$S_x = 1.233 \text{ in}^3$$

$$M := 0.147 \text{ k-ft (FROM PG. 10)}$$

$$F_b := 15.15 \text{ ksi}$$

$$S_{\text{req}} := \frac{M \cdot 12}{F_b}$$

$$S_{\text{req}} = 0.116 \text{ in}^3 < S_x = 1.233 \text{ in}^3 \quad \text{OK}$$

$$\Delta = L / 5688 < L / 175 \quad \text{OK (FROM PG. 10)}$$

6. CHECK REACTION AT MULLION ENDS

$$R_{\text{end}} = 127 \text{ lb} \quad (\text{FROM PG. 9})$$

7. CHECK SHEAR CAPACITY FOR ANCHORS

$$V_{\text{allow}} := 384 \text{ lb} > R_{\text{end}} = 127 \text{ lb} \quad \text{OK (FOR 1/4" } \phi \text{ TAPCONS, FROM PG. 15)}$$

$$V_a := 1100 \text{ lb} > R_{\text{end}} = 127 \text{ lb} \quad \text{OK (FOR 3/8" } \phi \text{ BOLT, FROM PG. 16)}$$

$$V_{\text{ult}} := 1395 \text{ lb} \quad (\text{FOR 1/4-14 SCREWS, FROM PG. 17})$$

$$V_a := \frac{V_{\text{ult}}}{3} \quad (\text{WITH S.F. OF 3})$$

$$V_a = 465 \text{ lb} > R_{\text{end}} = 127 \text{ lb} \quad \text{OK}$$

$$V_a := 190 \text{ lb} > R_{\text{end}} = 127 \text{ lb} \quad \text{OK (FOR #14 WOOD SCREW, FROM PG. 18)}$$

8. CHECK REACTION AT INTERMEDIATE ANCHOR IN JAMB

$$R_{\text{end}} = 381 \text{ lb} \quad (\text{FROM PG. 9})$$

9. CHECK SHEAR CAPACITY FOR ANCHORS

$$V_{\text{allow}} := 384 \text{ lb} > R_{\text{end}} = 381 \text{ lb} \quad \text{OK (FOR 1/4" } \phi \text{ TAPCONS, FROM PG. 15)}$$

$$V_a := 1100 \text{ lb} > R_{\text{end}} = 381 \text{ lb} \quad \text{OK (FOR 3/8" } \phi \text{ BOLT, FROM PG. 16)}$$

$$V_{\text{ult}} := 1395 \text{ lb} \quad (\text{FOR 1/4-14 SCREWS, FROM PG. 17})$$

$$V_a := \frac{V_{\text{ult}}}{3} \quad (\text{WITH S.F. OF 3})$$

$$V_a = 465 \text{ lb} > R_{\text{end}} = 381 \text{ lb} \quad \text{OK}$$

$$V_a := 190 \text{ lb} \quad (\text{FOR #14 WOOD SCREW, FROM PG. 18})$$

$$V_{\text{tot}} := V_a \cdot 2 \quad (\text{FOR (2) SCREWS})$$

$$V_{\text{tot}} = 380 \text{ lb} \sim R_{\text{end}} = 381 \text{ lb} \quad \text{OK}$$

10. ANALYSIS FOR TRANSOM HEAD

CHECK STRESS AND DEFLECTION

$$F_b \text{ FOR ALUMINUM} = 25 \text{ ksi} / 1.65 = 15.15 \text{ ksi}$$

$$F_b \text{ FOR STEEL} = 36 \text{ ksi} \times 0.67 = 24 \text{ ksi}$$

$$I_x = 2.888 \text{ in}^4$$

$$S_x = 1.274 \text{ in}^3$$

$$M := 0.07 \text{ k-ft (FROM PG. 11)}$$

$$F_b := 15.15 \text{ ksi}$$

$$S_{\text{req}} := \frac{M \cdot 12}{F_b}$$

$$S_{\text{req}} = 0.055 \text{ in}^3 < S_x = 1.274 \text{ in}^3 \text{ OK}$$

$$\Delta = 0.016 \text{ in} < L / 175 \text{ OK (FROM PG. 11)}$$

11. ANALYSIS FOR NARROW DOOR STILE

CHECK STRESS AND DEFLECTION

$$F_b \text{ FOR ALUMINUM} = 25 \text{ ksi} / 1.65 = 15.15 \text{ ksi}$$

$$F_b \text{ FOR STEEL} = 36 \text{ ksi} \times 0.67 = 24 \text{ ksi}$$

$$I_x = 0.408 \text{ in}^4$$

$$S_x = 0.494 \text{ in}^3$$


$$M := 0.036 \text{ k-ft (FROM PG. 14)}$$

$$F_b := 15.15 \text{ ksi}$$

$$S_{\text{req}} := \frac{M \cdot 12}{F_b}$$

$$S_{\text{req}} = 0.029 \text{ in}^3 < S_x = 0.494 \text{ in}^3 \text{ OK}$$

$$\Delta = L / 6082 < L / 175 \text{ OK (FROM PG. 14)}$$

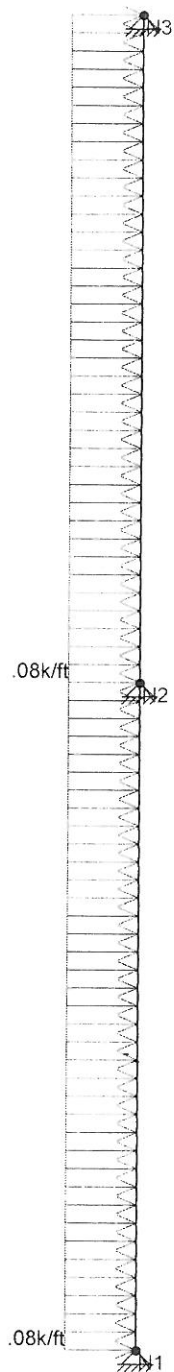

Loads: BLC 1, WIND LOAD
Results for LC 1, WIND LOAD

Broadway Engineering, P.A.
Elizabeth A Broadway
BE-4033

CORAL ARCH. PROD. - ELEV. E1

July 13, 2012 at 11:15 AM
4033-4.r2d

Company : Broadway Engineering, P.A.
 Designer : Elizabeth A Broadway
 Job Number : BE-4033

CORAL ARCH. PROD. - ELEV. E1

July 13, 2012

11:15 AM

Checked By: _____

General Material Properties

	Label	E [ksi]	G [ksi]	Nu	Therm (1/E5 F)	Density[k/ft^3]
1	gen_Alum	10100	4077	.3	1.29	.173

General Section Sets

	Label	Shape	Type	Material	A [in2]	I (90,270) [in4]	I (0,180) [in4]
1	FL209/104 JAMB		Column	gen_Alum	1.141	.275	2.7

Member Primary Data

	Label	I Joint	J Joint	Rotate(deg)	Section/Shape	Design List	Type	Material	Design Rules
1	M1	N1	N2		FL209/104 JAMB	None	Column	gen_Alum	Default
2	M2	N2	N3		FL209/104 JAMB	None	Column	gen_Alum	Default

Joint Coordinates and Temperatures

	Label	X [ft]	Y [ft]	Temp [F]
1	N1	0	0	0
2	N2	0	4.083	0
3	N3	0	8.167	0

Joint Boundary Conditions

	Joint Label	X [k/in]	Y [k/in]	Rotation[k-ft/rad]
1	N1	Reaction	Reaction	
2	N2	Reaction	Reaction	
3	N3	Reaction	Reaction	

Member Distributed Loads (BLC 1 : WIND LOAD)

	Member Label	-Direction	Start Magnitude[k/ft.d.]	End Magnitude[k/ft.d.]	Start Location[ft.%]	End Location[ft.%]
1	M1	X	.08	.08	0	0
2	M2	X	.08	.08	0	0

Basic Load Cases

	BLC Description	Category	X Gravity	Y Gravity	Joint	Point	Distributed
1	WIND LOAD	WL					2

Load Combinations

	Description	Sol...	PD...	SR...	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor
1	WIND LOAD	Yes			1	1								

Joint Reactions

	LC	Joint Label	X [k]	Y [k]	MZ [k-ft]
1	1	N1	-123	0	0
2	1	N2	-408	0	0
3	1	N3	-123	0	0
4	1	Totals:	-653	0	
5	1	COG (ft):	NC	NC	

7

Company : Broadway Engineering, P.A.
 Designer : Elizabeth A Broadway
 Job Number : BE-4033

CORAL ARCH. PROD. - ELEV. E1

July 13, 2012

11:15 AM


Checked By: _____

Member Section Forces

	LC	Member Label	Sec	Axial[k]	Shear[k]	Moment[k-ft]
1	1	M1	1	0	.123	0
2			2	0	.041	-.084
3			3	0	-.041	-.084
4			4	0	-.122	0
5			5	0	-.204	.166
6	1	M2	1	0	.204	.166
7			2	0	.122	0
8			3	0	.041	-.084
9			4	0	-.041	-.084
10			5	0	-.123	0

Member Section Deflections

	LC	Member Label	Sec	x [in]	y [in]	(n) L/y Ratio
1	1	M1	1	0	0	NC
2			2	0	-.006	7852.428
3			3	0	-.007	6607.568
4			4	0	-.004	NC
5			5	0	0	NC
6	1	M2	1	0	0	NC
7			2	0	-.004	NC
8			3	0	-.007	6597.953
9			4	0	-.006	7842.457
10			5	0	0	NC

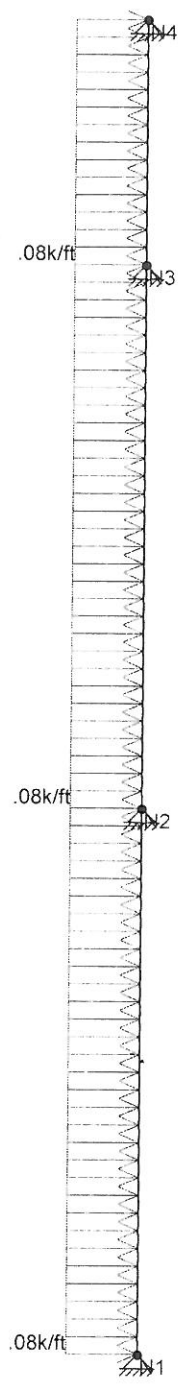

Loads: BLC 1, WIND LOAD
Results for LC 1, WIND LOAD

Broadway Engineering, P.A.	CORAL ARCH. PROD. - ELEV. E2	
Elizabeth A Broadway		July 13, 2012 at 11:18 AM
BE-4033		4033-5.r2d

Company : Broadway Engineering, P.A.
 Designer : Elizabeth A Broadway
 Job Number : BE-4033

CORAL ARCH. PROD. - ELEV. E2

July 13, 2012

11:18 AM

Checked By: _____

General Material Properties

	Label	E [ksi]	G [ksi]	Nu	Therm (1/E5 F)	Density[k/ft^3]
1	gen_Alum	10100	4077	.3	1.29	.173

General Section Sets

	Label	Shape	Type	Material	A [in2]	I (90,270) [in4]	I (0,180) [in4]
1	FL209/104 JAMB		Column	gen_Alum	1.141	.275	2.7

Member Primary Data

	Label	I Joint	J Joint	Rotate(deg)	Section/Shape	Design List	Type	Material	Design Rules
1	M1	N1	N2		FL209/104 JAMB	None	Column	gen_Alum	Default
2	M2	N2	N3		FL209/104 JAMB	None	Column	gen_Alum	Default
3	M3	N3	N4		FL209/104 JAMB	None	Column	gen_Alum	Default

Joint Coordinates and Temperatures

	Label	X [ft]	Y [ft]	Temp [F]
1	N1	0	0	0
2	N2	0	4.083	0
3	N3	0	8.167	0
4	N4	0	10	0

Joint Boundary Conditions

	Joint Label	X [k/in]	Y [k/in]	Rotation[k-ft/rad]
1	N1	Reaction	Reaction	
2	N2	Reaction	Reaction	
3	N3	Reaction	Reaction	
4	N4	Reaction	Reaction	

Member Distributed Loads (BLC 1 : WIND LOAD)

	Member Label	Direction	Start Magnitude[k/ft.d...]	End Magnitude[k/ft.d...]	Start Location[ft.%]	End Location[ft.%]
1	M1	X	.08	.08	0	0
2	M2	X	.08	.08	0	0
3	M3	X	.08	.08	0	0

Basic Load Cases

	BLC Description	Category	X Gravity	Y Gravity	Joint	Point	Distributed
1	WIND LOAD	WL					3

Load Combinations

	Description	Sol...	PD...	SR...	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor
1	WIND LOAD	Yes			1	1								

Joint Reactions

	LC	Joint Label	X [k]	Y [k]	MZ [k-ft]
1	1	N1	-127	0	0
2	1	N2	-381	0	0

Company : Broadway Engineering, P.A.
 Designer : Elizabeth A Broadway
 Job Number : BE-4033 CORAL ARCH. PROD. - ELEV. E2

July 13, 2012

11:18 AM

Checked By: _____

Joint Reactions (Continued)

	LC	Joint Label	X [k]	Y [k]	MZ [k-ft]
3	1	N3	-0.259	0	0
4	1	N4	-0.033	0	0
5	1	Totals:	-0.8	0	
6	1	COG (ft):	NC	NC	

Member Section Forces

	LC	Member Label	Sec	Axial[k]	Shear[k]	Moment[k-ft]
1	1	M1	1	0	.127	0
2			2	0	.046	-.088
3			3	0	-.036	-.093
4			4	0	-.118	-.014
5			5	0	-.199	147
6	1	M2	1	0	.181	.147
7			2	0	.1	.004
8			3	0	.018	-.056
9			4	0	-.064	-.033
10			5	0	-.145	.074
11	1	M3	1	0	.114	.074
12			2	0	.077	.03
13			3	0	.04	.004
14			4	0	.004	-.007
15			5	0	-.033	0

Member Section Deflections

	LC	Member Label	Sec	x [in]	y [in]	(n) L/y Ratio
1	1	M1	1	0	0	NC
2			2	0	-.007	7011.005
3			3	0	-.009	5688.423
4			4	0	-.005	NC
5			5	0	0	NC
6	1	M2	1	0	0	NC
7			2	0	-.002	NC
8			3	0	-.004	NC
9			4	0	-.003	NC
10			5	0	0	NC
11	1	M3	1	0	0	NC
12			2	0	0	NC
13			3	0	0	NC
14			4	0	0	NC
15			5	0	0	NC

Scope :

Rev: 560100
User: KW-0601564, Ver 5.6.1, 25-Oct-2002
(c)1983-2002 ENERCALC Engineering Software

Single Span Beam Analysis

Page 1
c:\ec55\4033.ecw:Calculations

Description ELEV. E2 - FL207 DOOR HEADER - PIVOT

General Information

Center Span	6.00 ft	Moment of Inertia	2.888 in ⁴
Left Cantilever	ft	Elastic Modulus	10,100 ksi
Right Cantilever	ft	Beam End Fixity	Pin-Pin

Trapezoidal Loads



Magnitude @ Left	k/ft	0.025 k/ft	k/ft	k/ft
Magnitude @ Right	0.025 k/ft	k/ft	k/ft	k/ft
Dist. To Left Side	ft	3.000 ft	ft	ft
Dist. To Right Side	3.000 ft	6.000 ft	ft	ft

Query Values

Center Location	0.000 ft	Left Cant	0.000 ft	Right Cant	0.000 ft
Moment	0.00 k-ft		0.00 k-ft		0.00 k-ft
Shear	0.04 k		0.00 k		0.00 k
Deflection	0.00000 in		0.00000 in		0.00000 in

Summary

Moments...				Shears...				Reactions...			
Max + @ Center	0.07 k-ft	at	3.01 ft	@ Left	0.04 k	@ Left	0.04 k	@ Left	0.04 k		
Max - @ Center	0.00 k-ft	at	0.00 ft	@ Right	0.04 k	@ Right	0.04 k	@ Right	0.04 k		
@ Left Cant	0.00 k-ft			Maximum	0.04 k						
@ Right Cant	0.00 k-ft			Deflections...							
Maximum =	0.07 k-ft			@ Center	-0.016 in	at	3.01 ft				
				@ Left Cant.	0.000 in	at	0.00 ft				
				@ Right Cant	0.000 in	at	0.00 ft				

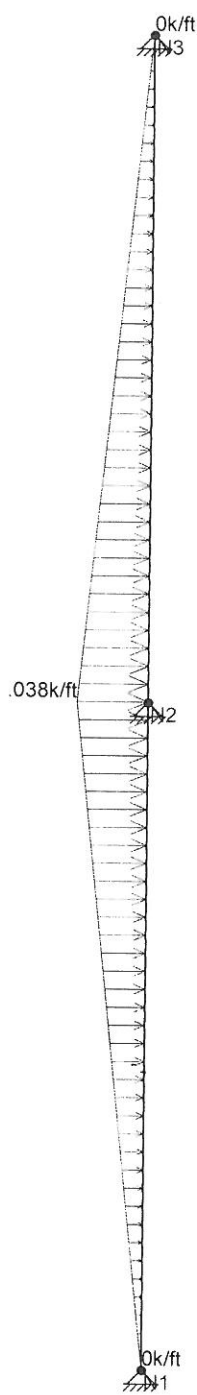

Loads: BLC 1, WIND LOAD
Results for LC 1, WIND LOAD

Broadway Engineering, P.A.	CORAL ARCH. PROD. - NARROW STILE	
Elizabeth A Broadway		July 13, 2012 at 11:22 AM
BE-4033		4033-6.r2d

Company : **Broadway Engineering, P.A.**
 Designer : **Elizabeth A Broadway**
 Job Number : **BE-4033** **CORAL ARCH. PROD. - NARROW STILE**

July 13, 2012
 11:22 AM
 Checked By: _____

General Material Properties

	Label	E [ksi]	G [ksi]	Nu	Therm (1/E5 F)	Density[k/ft^3]
1	gen_Alum	10100	4077	.3	1.29	.173

General Section Sets

	Label	Shape	Type	Material	A [in2]	I (90,270) [in4]	I (0,180) [in4]
1	D103 STILE		Column	gen_Alum	1.104	.501	.408

Member Primary Data

	Label	I Joint	J Joint	Rotate(deg)	Section/Shape	Design List	Type	Material	Design Rules
1	M1	N1	N2		D103 STILE	None	Column	gen_Alum	Default
2	M2	N2	N3		D103 STILE	None	Column	gen_Alum	Default

Joint Coordinates and Temperatures

	Label	X [ft]	Y [ft]	Temp [F]
1	N1	0	0	0
2	N2	0	3.75	0
3	N3	0	7.5	0

Joint Boundary Conditions

	Joint Label	X [k/in]	Y [k/in]	Rotation[k-ft/rad]
1	N1	Reaction	Reaction	
2	N2	Reaction	Reaction	
3	N3	Reaction	Reaction	

Member Distributed Loads (BLC 1 : WIND LOAD)

	Member Label	Direction	Start Magnitude[k/ft,d...]	End Magnitude[k/ft,d...]	Start Location[ft,%]	End Location[ft,%]
1	M1	X	0	.038	0	3.75
2	M2	X	.038	0	0	3.75

Basic Load Cases

	BLC Description	Category	X Gravity	Y Gravity	Joint	Point	Distributed
1	WIND LOAD	WL					2

Load Combinations

	Description	Sol... PD...	SR...	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor	BLC Factor
1	WIND LOAD	Yes		1	1										

Joint Reactions

	LC	Joint Label	X [k]	Y [k]	MZ [k-ft]
1	1	N1	-.014	0	0
2	1	N2	-.114	0	0
3	1	N3	-.014	0	0
4	1	Totals:	-.142	0	
5	1	COG (ft):	NC	NC	

Company : Broadway Engineering, P.A.
 Designer : Elizabeth A Broadway
 Job Number : BE-4033 CORAL ARCH. PROD. - NARROW STILE

July 13, 2012
 11:22 AM
 Checked By: _____

14

Member Section Forces

	LC	Member Label	Sec	Axial[k]	Shear[k]	Moment[k-ft]
1	1	M1	1	0	.014	0
2			2	0	.01	-.012
3			3	0	-.004	-.016
4			4	0	-.026	-.003
5			5	0	-.057	.036
6	1	M2	1	0	.057	.036
7			2	0	.026	-.003
8			3	0	.004	-.016
9			4	0	-.01	-.012
10			5	0	-.014	0

Member Section Deflections

	LC	Member Label	Sec	x [in]	y [in]	(n) L/y Ratio
1	1	M1	1	0	0	NC
2			2	0	-.006	7787.774
3			3	0	-.007	6082.004
4			4	0	-.004	NC
5			5	0	0	NC
6	1	M2	1	0	0	NC
7			2	0	-.004	NC
8			3	0	-.007	6082.004
9			4	0	-.006	7787.774
10			5	0	0	NC



Buildex TAPCON® CONCRETE & MASONRY ANCHOR

GENERAL NOTES:


- THIS PRODUCT HAS BEEN DESIGNED & TESTED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE(HIGH VELOCITY HURRICANE ZONE) AND THE FOLLOWING STANDARDS: ASTM A308, A307, A36, A572, & A575. TAPCON® IS A REGISTERED TRADEMARK OF BUILDDEX DIVISION OF ILLINOIS TOOL WORKS, INC.
- ANCHOR SHALL BE MADE IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS AND THIS NOTICE OF ACCEPTANCE.
- CONCRETE SHALL CONFORM TO ASTM C301 SPECIFICATIONS. WITH STRENGTH PROPERTIES AS SPECIFIED HEREIN. HOLLOW AND GROUT-FILLED CONCRETE BLOCK SHALL CONFORM TO ASTM C-90.
- REFER TO THE FOLLOWING TEST REPORTS:
 - #HETI-00-4160 (10/25/2000)
 - #HETI-00-4092 (02/25/2000)
 - #HETI-00-4153 (10/25/2000)
 - #HETI-00-4072 (02/25/2000)
 - #HETI-01-5029 (05/07/2001)
 - #HETI-01-5027 (05/07/2001)
 - #HETI-01-5028 (05/07/2001)
 - #PR-ASPH-01-CL09 (01/16/2001)
 - #PR-ASPH-01-CL09 (01/16/2001)
 - #PRI 01078 (08/27/2001)
 - #APPLIED RESEARCH LABORATORIES
 - #ARL 30291 (01/22/2002)
 - #ARL 30292 (01/29/2002)
 - #ARL 30293 (01/30/2002)
 - #ARL 30294 (01/30/2002)
 - #CEM 25-7654-PS (06/03/1996)
 - #CEM 25-7654-PS (06/03/1996)
 - #CELOTEX CORPORATION TESTING SERVICES
 - #MTS 52061.4-PS (06/14/2000)

- ANCHOR SHALL BE 1/4" LONGER THAN EMBEDMENT WITH 0.171" DIAMETER.
- ALLOWABLE LOADS ARE BASED ON AVERAGE ULTIMATE TEST LOAD DIVIDED BY 4.
- CENTER TO CENTER DISTANCE OF 2-1/4" IS NECESSARY FOR 100% CAPACITY AND 1-1/8" FOR 50% CAPACITY.
- REFERENCE SHEET 2 FOR ADDITIONAL ANCHOR DIMENSIONS.



SCOTS STAINLESS STEEL HEAD WITH WASHER

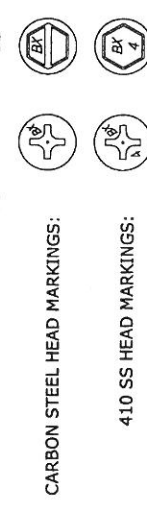

CARBON STEEL HEAD MARKINGS:

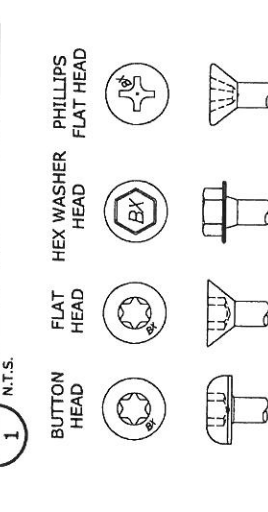

410 SS HEAD MARKINGS:

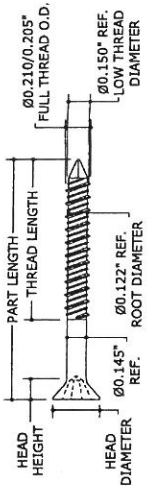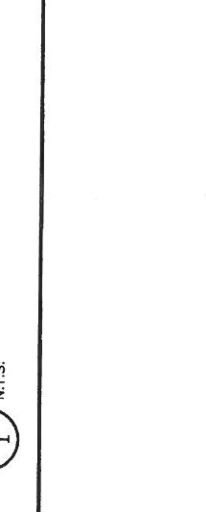


- PILOT HOLE SHALL BE 1/4" LONGER THAN EMBEDMENT WITH 0.171" DIAMETER.
- ALLOWABLE LOADS ARE BASED ON AVERAGE ULTIMATE TEST LOAD DIVIDED BY 4.
- CENTER TO CENTER DISTANCE OF 2-1/4" IS NECESSARY FOR 100% CAPACITY AND 1-1/8" FOR 50% CAPACITY.
- REFERENCE SHEET 2 FOR ADDITIONAL ANCHOR DIMENSIONS.

3/16" TAPCON




- PILOT HOLE SHALL BE 1/4" LONGER THAN EMBEDMENT WITH 0.200" DIAMETER.
- ALLOWABLE LOADS ARE BASED ON AVERAGE ULTIMATE TEST LOAD DIVIDED BY 4.
- CENTER TO CENTER DISTANCE OF 3" IS NECESSARY FOR 100% CAPACITY AND 1-1/2" FOR 50% CAPACITY.
- REFERENCE SHEET 2 FOR ADDITIONAL ANCHOR DIMENSIONS.

1/4" TAPCON



- PILOT HOLE SHALL BE 1/4" LONGER THAN EMBEDMENT WITH 0.263" DIAMETER.
- ALLOWABLE LOADS ARE BASED ON AVERAGE ULTIMATE TEST LOAD DIVIDED BY 4.
- CENTER TO CENTER DISTANCE OF 3-3/4" IS NECESSARY FOR 100% CAPACITY AND 1-7/8" FOR 50% CAPACITY.
- REFERENCE SHEET 2 FOR ADDITIONAL ANCHOR DIMENSIONS.

5/16" TAPCON

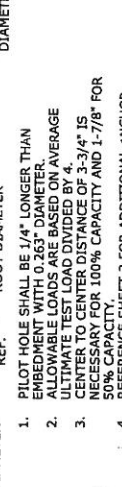

- PILOT HOLE SHALL BE 1/4" LONGER THAN EMBEDMENT WITH 0.363" DIAMETER.
- ALLOWABLE LOADS ARE BASED ON AVERAGE ULTIMATE TEST LOAD DIVIDED BY 4.
- CENTER TO CENTER DISTANCE OF 4-1/4" IS NECESSARY FOR 100% CAPACITY AND 1-7/8" FOR 50% CAPACITY.
- REFERENCE SHEET 2 FOR ADDITIONAL ANCHOR DIMENSIONS.

3/16" CARBON STEEL TAPCONS

EMBEDMENT	EDGE DISTANCE	TENSION (LB)	SHEAR (LB)
HOLLOW BLOCK	1-1/4"	94	112
CONCRETE (3182 PSI MIN)	1"	128	147
	1-1/8"	354	160
	2-3/8"	354	229

1/4" TAPCONS

EMBEDMENT	EDGE DISTANCE	TENSION (LB)	SHEAR (LB)
HOLLOW BLOCK	1-1/4"	117	94
CONCRETE (3182 PSI MIN)	1"	208	115
	2-1/2"	212	287
	1"	510	115
	2-1/2"	515	384

5/16" CARBON STEEL TAPCON XL

EMBEDMENT	EDGE DISTANCE	TENSION (LB)	SHEAR (LB)
HOLLOW BLOCK	1-3/4"†	261 LB	570 LB
CONCRETE (2889 PSI MIN)	1-1/4"	282	333
	2-3/16"	301	431
	3-1/8"	301	543
	1-9/16"	505	382
	2-3/16"	563	625
	3-1/8"	593	627
	1-9/16"	713	489
	2-3/16"	780	812
	3-1/8"	788	852
GROUT FILLED BLOCK	1-3/4"†	487	706
	2-1/4"	942	785
THRU 2x WOOD BUCK (G=0.38 MIN) TO 3KSI MIN CONCRETE	1-3/4"††	—	312

† EMBEDMENT IS THROUGH 1-1/4" FACE SHELL OF HOLLOW BLOCK

†† EMBEDMENT DEPTH IS INTO 3KSI CONCRETE, WITH THE WOOD BUCK LOCATED BETWEEN CONCRETE AND SIDE MEMBER

FRANK L. BERNARDO, P.E.
#20046549
03/10/2008

ENGINEERING
160 SW 12TH AVENUE, #106
DEERFIELD BEACH, FL 33442
P: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #0085
A FRANK L. BERNARDO, P.E., INC. INNOVATION

Buildex DIVISION OF ILLINOIS TOOL WORKS, INC.
1349 WEST BRYN MAWR AVENUE
ITW IL 60143
TAPCON MASONRY FASTENERS
MIAMI-DADE NOTICE OF ACCEPTANCE

DATE	CHKD	DATE	CHKD
03/06/08	KL	03/06/08	KL

08-ITW-0004
SCALE: 01
PAGE DESCRIPTION:
PRODUCT REVIEWED
in compliance with the Florida
Building Code
Acceptance No. 02-1126-10
Expiration Date 02/22/2013
By: [Signature]
Miami Trade Product Control
Disables

BOLTED CONNECTIONS

TABLE V-4.5(A) Allowable Loads, in Kips for A307 Bolts (Shear = 10ksi)

Bolt Dia. (in.)	Area (in. ²)	Single Shear (kips)	Double Shear (kips)	BEARING VALUE (kips)											
				F _p (ksi)	THICKNESS (in.)										
					0.024	0.030	0.036	0.048	0.060	0.075	0.105	0.135	0.164	0.194	0.224
¼	0.0491	0.49	0.98	1.50 x 50	0.45	0.56	0.68	0.90	1.12	1.41	1.97	2.53	3.08	3.64	4.20
				1.35 x 50	0.40	0.51	0.61	0.81	1.01	1.26	1.77	2.28	2.77	3.27	3.78
				1.00 x 50	0.30	0.38	0.45	0.60	0.75	0.94	1.31	1.69	2.05	2.42	2.80
⅜	0.1104	1.10	2.21	1.50 x 50	0.68	0.84	1.01	1.35	1.69	2.11	2.95	3.80	4.61	5.46	6.30
				1.35 x 50	0.61	0.76	0.91	1.22	1.52	1.90	2.66	3.42	4.15	4.91	5.67
				1.00 x 50	0.45	0.56	0.68	0.90	1.12	1.41	1.97	2.53	3.08	3.64	4.20
½	0.1963	1.96	3.93	1.50 x 50	0.90	1.12	1.35	1.80	2.25	2.81	3.94	5.06	6.15	7.28	8.40
				1.35 x 50	0.81	1.01	1.22	1.62	2.02	2.53	3.54	4.55	5.54	6.55	7.56
				1.00 x 50	0.60	0.75	0.90	1.20	1.50	1.88	2.62	3.38	4.10	4.85	5.60
⅝	0.3068	3.07	6.14	1.50 x 50	1.12	1.41	1.69	2.25	2.81	3.52	4.92	6.33	7.69	9.09	10.50
				1.35 x 50	1.01	1.26	1.52	2.02	2.53	3.16	4.43	5.70	6.92	8.18	9.45
				1.00 x 50	0.75	0.94	1.12	1.50	1.88	2.34	3.28	4.22	5.12	6.06	7.00
¾	0.4418	4.42	8.84	1.50 x 50	1.35	1.69	2.02	2.70	3.38	4.22	5.91	7.59	9.22	10.91	12.60
				1.35 x 50	1.22	1.52	1.82	2.43	3.04	3.80	5.32	6.83	8.30	9.82	11.34
				1.00 x 50	0.90	1.12	1.35	1.80	2.25	2.81	3.94	5.06	6.15	7.28	8.40
1	0.6013	6.01	12.03	1.50 x 50	1.58	1.97	2.36	3.15	3.94	4.92	6.89	8.86	10.76	12.73	14.70
				1.35 x 50	1.42	1.77	2.13	2.84	3.54	4.43	6.20	7.97	9.69	11.46	13.23
				1.00 x 50	1.05	1.31	1.58	2.10	2.62	3.28	4.59	5.91	7.18	8.49	9.80
1	0.7854	7.85	15.71	1.50 x 50	1.80	2.25	2.70	3.60	4.50	5.62	7.88	10.12	12.30	14.55	16.80
				1.35 x 50	1.62	2.02	2.43	3.24	4.05	5.06	7.09	9.11	11.07	13.10	15.12
				1.00 x 50	1.20	1.50	1.80	2.40	3.00	3.75	5.25	6.75	8.20	9.70	11.20

TABLE V-4.5(B) Allowable Loads in Kips for A325 Bolts • Threading Excluded from Shear Plane

¼	0.0491	1.47	2.94	1.50 x 50	0.45	0.56	0.68	0.90	1.12	1.41	1.97	2.53	3.08	3.64	4.20
				1.35 x 50	0.40	0.51	0.61	0.81	1.01	1.26	1.77	2.28	2.77	3.27	3.78
				1.00 x 50	0.30	0.38	0.45	0.60	0.75	0.94	1.31	1.69	2.05	2.42	2.80
⅜	0.1104	3.31	6.62	1.50 x 50	0.68	0.84	1.01	1.35	1.69	2.11	2.95	3.80	4.61	5.46	6.30
				1.35 x 50	0.61	0.76	0.91	1.22	1.52	1.90	2.66	3.42	4.15	4.91	5.67
				1.00 x 50	0.45	0.56	0.68	0.90	1.12	1.41	1.97	2.53	3.08	3.64	4.20
½	0.1963	5.89	11.78	1.50 x 50	0.90	1.12	1.35	1.80	2.25	2.81	3.94	5.06	6.15	7.28	8.40
				1.35 x 50	0.81	1.01	1.22	1.62	2.02	2.53	3.54	4.55	5.54	6.55	7.56
				1.00 x 50	0.60	0.75	0.90	1.20	1.50	1.88	2.62	3.38	4.10	4.85	5.60
⅝	0.3068	9.20	18.41	1.50 x 50	1.12	1.41	1.69	2.25	2.81	3.52	4.92	6.33	7.69	9.09	10.50
				1.35 x 50	1.01	1.26	1.52	2.02	2.53	3.16	4.43	5.70	6.92	8.18	9.45
				1.00 x 50	0.75	0.94	1.12	1.50	1.88	2.34	3.28	4.22	5.12	6.06	7.00
¾	0.4418	13.25	26.51	1.50 x 50	1.35	1.69	2.02	2.70	3.38	4.22	5.91	7.59	9.22	10.91	12.60
				1.35 x 50	1.22	1.52	1.82	2.43	3.04	3.80	5.32	6.83	8.30	9.82	11.34
				1.00 x 50	0.90	1.12	1.35	1.80	2.25	2.81	3.94	5.06	6.15	7.28	8.40
1	0.6013	18.04	36.08	1.50 x 50	1.58	1.97	2.36	3.15	3.94	4.92	6.89	8.86	10.76	12.73	14.70
				1.35 x 50	1.42	1.77	2.13	2.84	3.54	4.43	6.20	7.97	9.69	11.46	13.23
				1.00 x 50	1.05	1.31	1.58	2.10	2.62	3.28	4.59	5.91	7.18	8.49	9.80
1	0.7854	23.56	47.12	1.50 x 50	1.80	2.25	2.70	3.60	4.50	5.62	7.88	10.12	12.30	14.55	16.80
				1.35 x 50	1.62	2.02	2.43	3.24	4.05	5.06	7.09	9.11	11.07	13.10	15.12
				1.00 x 50	1.20	1.50	1.80	2.40	3.00	3.75	5.25	6.75	8.20	9.70	11.20

TABLE V-4.5(C) Allowable Loads in Kips for A325 Bolts • Threading Not Excluded from Shear Plane

¼	0.0491	1.03	2.06	1.50 x 50	0.45	0.56	0.68	0.90	1.12	1.41	1.97	2.53	3.08	3.64	4.20
				1.35 x 50	0.40	0.51	0.61	0.81	1.01	1.26	1.77	2.28	2.77	3.27	3.78
				1.00 x 50	0.30	0.38	0.45	0.60	0.75	0.94	1.31	1.69	2.05	2.42	2.80
⅜	0.1104	2.32	4.64	1.50 x 50	0.68	0.84	1.01	1.35	1.69	2.11	2.95	3.80	4.61	5.46	6.30
				1.35 x 50	0.61	0.76	0.91	1.22	1.52	1.90	2.66	3.42	4.15	4.91	5.67
				1.00 x 50	0.45	0.56	0.68	0.90	1.12	1.41	1.97	2.53	3.08	3.64	4.20
½	0.1963	4.12	8.24	1.50 x 50	0.90	1.12	1.35	1.80	2.25	2.81	3.94	5.06	6.15	7.28	8.40
				1.35 x 50	0.81	1.01	1.22	1.62	2.02	2.53	3.54	4.55	5.54	6.55	7.56
				1.00 x 50	0.60	0.75	0.90	1.20	1.50	1.88	2.62	3.38	4.10	4.85	5.60
⅝	0.3068	6.44	12.88	1.50 x 50	1.12	1.41	1.69	2.25	2.81	3.52	4.92	6.33	7.69	9.09	10.50
				1.35 x 50	1.01	1.26	1.52	2.02	2.53	3.16	4.43	5.70	6.92	8.18	9.45
				1.00 x 50	0.75	0.94	1.12	1.50	1.88	2.34	3.28	4.22	5.12	6.06	7.00
¾	0.4418	9.28	18.56	1.50 x 50	1.35	1.69	2.02	2.70	3.38	4.22	5.91	7.59	9.22	10.91	12.60
				1.35 x 50	1.22	1.52	1.82	2.43	3.04	3.80	5.32	6.83	8.30	9.82	11.34
				1.00 x 50	0.90	1.12	1.35	1.80	2.25	2.81	3.94	5.06	6.15	7.28	8.40
1	0.6013	12.63	25.25	1.50 x 50	1.58	1.97	2.36	3.15	3.94	4.92	6.89	8.86	10.76	12.73	14.70
				1.35 x 50	1.42	1.77	2.13	2.84	3.54	4.43	6.20	7.97	9.69	11.46	13.23
				1.00 x 50	1.05	1.31	1.58	2.10	2.62	3.28	4.59	5.91	7.18	8.49	9.80
1	0.7854	16.49	32.99	1.50 x 50	1.80	2.25	2.70	3.60	4.50	5.62	7.88	10.12	12.30	14.55	16.80
				1.35 x 50	1.62	2.02	2.43	3.24	4.05	5.06	7.09	9.11	11.07	13.10	15.12
				1.00 x 50	1.20	1.50	1.80	2.40	3.00	3.75	5.25	6.75	8.20	9.70	11.20

Dril-Flex® Structural Fasteners

COMPARISON TO STAINLESS STEEL FASTENERS

300 series stainless steel fasteners will not rust, and, because of their low hardness, they also provide high resistance to hydrogen embrittlement failures. However, because stainless steel is galvanically incompatible with certain building materials – including steel and aluminum – it can cause other problems (see chart) when combined with these materials. Stainless steel fasteners trigger a sacrificial action in the aluminum or steel panel, which can lead to degradation of the panel and loosening of the fastener.

The dual-hardening process allows Dril-Flex fasteners to provide high strength and resistance to hydrogen embrittlement failures. Their unique Stalgard® finish provides corrosion resistance several times greater than other commonly-used finishes. Fasteners coated with Stalgard finish typically show no red rust or other base metal corrosion on significant surfaces even after 800 hours of 5% neutral salt spray exposure (ASTM B117).

If the environment is corrosive enough to significantly affect the Stalgard® finish, the potential for significant degradation of the aluminum/stainless steel assembly would also exist.

Galvanic Series

Anodic End	
Metal/Alloy	EMF (v)
Magnesium.....	-1.60
Zinc.....	-1.10
Alum (5000, 6000, 7000).....	-.75
Iron, Low Alloy Steels.....	-.70
Alum (2000).....	-.60
Lead.....	-.55
18% Chromium Steel.....	-.35
Naval Brass.....	-.30
Brass, Bronze.....	-.25
Austenitic Stainless (300 Series).....	-.20
Nickel.....	-.15
Silver.....	0
Gold.....	+15
Cathodic End	

In the presence of moisture, materials higher on the list will be sacrificial to materials lower on the list. The greater the EMF differential, the greater the sacrificial action of the anode to the cathode in a galvanic cell.

EMBRITTLMENT TESTING

Embrittlement testing of Dril-Flex fasteners was performed in accordance to ASTM F1624-06, "Standard Test Method for Measurement of Hydrogen Embrittlement in Steel by the Incremental Loading Method". Fastener lots were tested to determine their Threshold Stress Limits for both Internal Hydrogen Embrittlement and Environmental Hydrogen Embrittlement. Threshold Stress Limit is the stress level below which no time-dependent cracking will occur. Above this level, subcritical cracking that leads to time-delayed fracture or embrittlement may occur if the fastener is exposed to a hydrogen environment.

Embrittlement Test Results

- Dril-Flex fasteners have a hardness range of HRC 28 – 34, which is roughly equivalent to a SAE Grade 5 fastener (HRC 25 – 34).
- Dril-Flex fasteners showed resistance to the effect of hydrogen-assisted cracking when loaded to 75% of their tensile strength. This is within accepted industry guidelines for in-service loading conditions.
- Dril-Flex fasteners showed no degradation or failures in tensile strength below their Ultimate Tensile Strength.

SHEAR AND PULL-OUT VALUES

Pull-out Tests – Steel

Pull-out values shown are in lbs.

Screw Size	Point Type	Drill Cap	Steel							
			18	16	14	12	1/8	3/16	1/4	5/16
10-16	3	.150	396	501	634	1595	1693			
12-14	3	.187	396	527	710	1678	2061	2898		
1/4-14	3	.187	398	530	686	1950	2264	3919		
1/4-20	4	.312		516	649	1912	2296	2928	3561	4488
5/16-24	4	.312				2148	2573	4226	5424	6622

Shear Tests – Steel

Shear values shown are in lbs.

Screw Size	Point Type	Drill Cap	Steel							
			18-18 gage	18-14 gage	16-16 gage	14-14 gage	1/8"- 3/16"	3/16"- 1/4"	1/4"- 12 gage	
10-16	3	.150	1362	1733	1462					
12-14	3	.187	1315	2118	1655	1816				
1/4-14	3	.187	1395	2313	1681	2417	2600			
1/4-20	4	.312	1350	2086	1582	2450	2814	2810	2706	
5/16-24	4	.312					5486	5283	4761	

Pull-out Tests – Aluminum

Pull-out values shown are in lbs.

Screw Size	Point Type	Drill Cap	Aluminum 6063-T5		
			1/8"	1/4"	3/8"
10-16	3	.150			
12-14	3	.187	939	2286	
1/4-14	3	.187	1003	2424	
1/4-20	4	.312	897	2075	3683
5/16-24	4	.312	1043	2566	

Shear Tests – Aluminum

Shear values shown are in lbs.

Screw Size	Point Type	Drill Cap	Aluminum 6063-T5	
			1/8" - 1/8"	1/8" - 1/4"
10-16	3	.150	1466	
12-14	3	.187	1797	2483
1/4-14	3	.187	1996	2883
1/4-20	4	.312	2006	2926
5/16-24	4	.312	1849	2926

NOTE: All test setups and dimensions were as limited and outlined in AISI Test Method for Mechanically Fastened Cold-Formed Steel Connections (CF92-1) document. Performance values listed are ultimate values obtained under laboratory conditions. Appropriate safety factors should be applied for design purposes.

TABLE 6.31
Wood Screws—Lateral Load Design Values^{a,b}

Gage of Screw		6	7	8	9	10	12	14	16	18	20	24
	<i>D</i>	0.138	0.151	0.164	0.177	0.190	0.216	0.242	0.268	0.294	0.320	0.372
	<i>7D</i>	0.966	1.057	1.148	1.239	1.330	1.512	1.694	1.876	2.058	2.240	2.604
	<i>4D</i>	0.552	0.604	0.656	0.708	0.760	0.864	0.968	1.072	1.176	1.280	1.488
Species	I	91	109	129	150	173	224	281	345	415	492	664
Group ^c	II	75	90	106	124	143	185	232	284	342	406	548
	III	62	74	87	101	117	151	190	233	280	332	448
	IV	48	58	68	79	91	118	148	181	218	258	349

^aSource: *National Design Specification for Wood Construction* (3).

^bDesign values for lateral loads (shear), *P*, (lb) for screws embedded to approximately 7 times the shank diameter, *D*, into the member holding the point. For less penetration, reduce loads in proportion. Penetration should not be less than 4 times the shank diameter.

^cSee Tables 6.1 and 6.2 for species groups for sawn lumber and glued laminated timber, respectively.